

4717.3750 STANDARDS FOR POOLS WITH DIVING.

The dimensions of the pool and appurtenances in a diving area must meet the standards in this part.

A. There must be a completely unobstructed clear distance of 16 feet above the diving board measured from the center of the front end of the board. This area must extend at least eight feet behind, eight feet to each side, and 16 feet ahead of the measuring point.


B. Pools used for competitive diving must provide pool depths compatible with the level of competition anticipated.

C. Diving is not permitted, except in areas which conform to the minimum dimensions specified in this part.

D. The dimensions of the diving area in all pools must conform to the minimum dimensions specified in this part.

			Lengths		
Height of Diving Board	Water Depths		Minimum Overhang	Length of	
				Diving Well	Run-out
H	D_o	D_1	O_h	L_1	L_2
Deck Level or no board	6 ft.	8.5 ft.	3 ft.	12 ft.	10.5 ft.
1 m	6 ft.	10 ft.	5 ft.	12 ft.	15 ft.
3 m	6 ft.	12 ft.	5 ft.	13 ft.	21 ft.

			Clearances	
Height of Diving Board	Water Depths		Adjacent Board's	
			Center-to-Center	Center of Board to Sidewall
H	D_o	D_1		
Deck Level or no board	6 ft.	8.5 ft.	10 ft.	10 ft.
1 m	6 ft.	10 ft.	10 ft.	10 ft.
3 m	6 ft.	12 ft.	10 ft.	12 ft.

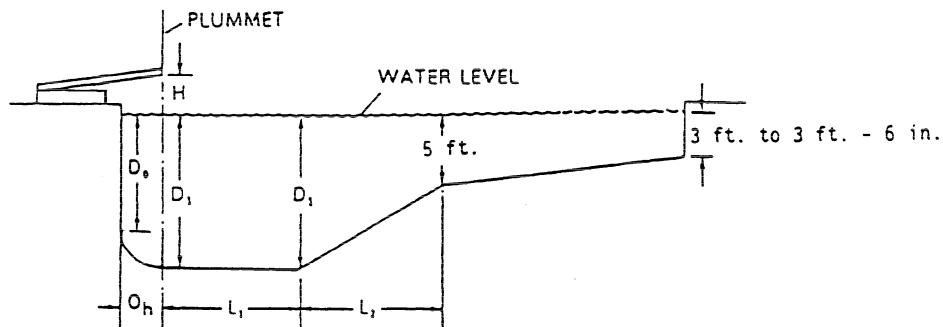

Statutory Authority: *MS s 144.05; 144.12; 144.123; 145A.02; 157.01*

History: *19 SR 1419; 19 SR 1637*

Published Electronically: *May 11, 2009*